

SUBMITTAL DATA - OUTDOOR UNIT VRA288L4M-2G

VRA072L4M-2G + VRA096L4M-2G + VRA120L4M-2G VRF LOW AMBIENT HEAT RECOVERY

Job:

- Location:
- Schedule No.:
- System Designation:

FEATURES

- Built-in Base Pan Heater
- · Hinged electrical box for ease of maintenance
- · High efficiency DC Inverter scroll compressors
- Split coil heat exchanger provides continuous

heating during defrost

SPECIFICATIONS

PERFORMANCE Nominal 288,000 Cooling Capacity¹ (Btu/h) Rated² 276,000 Ducted 10.30 EER Non-Ducted 10.90 Ducted 18.90 IFFR Non-Ducted 21.20 Simultaneous Heating and Ducted 22.20 Cooling Efficiency (SCHE) 22.50 Non-Ducted Heating Capacity¹ (Btu/h) 298,000 Ducted 3.35 COP47 Non-Ducted 3.50 Ducted 2.19 COP17 Non-Ducted 2.32 ELECTRICAL DATA

Power Supply ³ (V/Hz/Ph)		460/60/3
Minimum Circuit Ampacity (A)		27.6 + 32.1 + 34.4
Maximum Overcurrent Protection (A)		35 + 40 + 45
Compressor RLA (A)		10/9 + 12/11 + 13/12
No. of Compressors		2 + 2 + 2
Outdoor Fan Power Input (W)		(3) 750/750
Outdoor Fan FLA (A)		(3) 1.8/1.8
GENERAL DATA		
Connection Ratio		50% to 130%
Max # of Indoor Units		50 units
Refrigerant type		R-410A
Factory refrigerant charge		22 lbs.
DIMENSIONS		
Unit Dimensions (in)	Height	63-1/8
	Width	49-1/4
	Depth	30-1/8
Liquid Pipe Connection (in.)		1/2
Gas Pipe Connection (in.)		7/8
Net Weight (lb)		(3) 781

Engineer:

Architect:

Date:



WARRANTY⁴

- Compressor 10 year limited warranty
- All other components 10 year limited warranty

NOTES

- Cooling and Heating Capacity data is rated at the following conditions:
 Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Indoor
- 2. Complies with AHRI 1230-2014 testing standards
- 3. Operating Voltage Range: 423V to 497V
- 4. See Warranty for Details




SUBMITTAL DATA - OUTDOOR UNIT

VRA288L4M-2G

VRA072L4M-2G + VRA096L4M-2G + VRA120L4M-2G VRF LOW AMBIENT HEAT RECOVERY



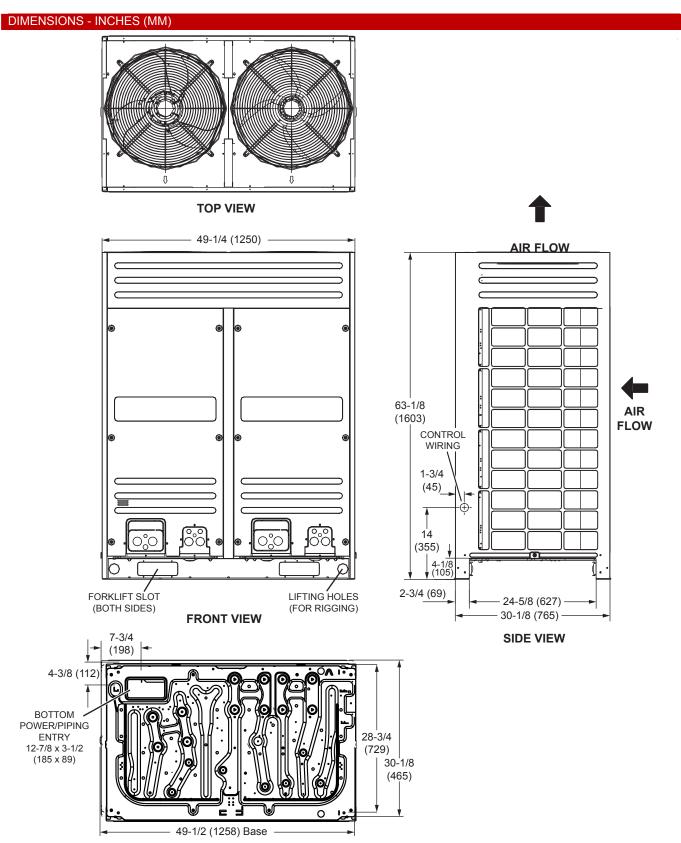

DISCLAIMER – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495611 (201802) ©2018 Lenn

BASE VIEW

©2018 Lennox Industries Inc.