

# SUBMITTAL DATA - OUTDOOR UNIT VPA168L4M-2G

### VPA072L4M-2G + VPA096L4M-2G VRF LOW AMBIENT HEAT PUMP

Engineer:

Architect:

Date:

For: 
□
Reference 
□
Approval 
□
Review □
Construction



#### WARRANTY<sup>3</sup>

- Compressor 10 year limited warranty
- · All other components 10 year limited warranty

#### NOTES

- Cooling and Heating Capacity data is rated at the following conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor
- Heating: 70°FDB Indoor, 47°FDB / 43°FWB Indoor
- 2. Complies with AHRI 1230-2014 testing standards
- 3. Operating Voltage Range: 423V to 497V
- 4. See Warranty for Details



Job:

Location:

Schedule No.: System Designation:

#### **FEATURES**

- Built-in Base Pan Heater
- · Hinged electrical box for ease of maintenance
- High efficiency DC Inverter scroll compressors
- Two-pipe heat pump

#### SPECIFICATIONS PERFORMANCE

PERFORMANCE		
Cooling Capacity <sup>1</sup> (Btu/h)	Nominal	168,000
	Rated <sup>2</sup>	160,000
EER	Ducted	10.80
	Non-Ducted	11.50
IEER	Ducted	20.20
	Non-Ducted	21.70
Heating Capacity <sup>1</sup> (Btu/h)		180,000
COP47	Ducted	3.60
	Non-Ducted	3.71
COP17	Ducted	2.29
	Non-Ducted	2.47
ELECTRICAL DATA		
Power Supply <sup>2</sup> (V/Hz/Ph)		460/60/3
Minimum Circuit Ampacity (A)		27.6 + 32.1
Maximum Overcurrent Protection (A)		35 + 40
Compressor RLA (A)		10/9 + 12/11
No. of Compressors		2 + 2
Outdoor Fan Power Input (W)		(2) 750/750
Outdoor Fan FLA (A)		(2) 1.8/1.8
GENERAL DATA		
Connection Ratio		50% to 130%
Max # of Indoor Units		29 units
Refrigerant type		R-410A
Factory refrigerant charge		22 lbs.
DIMENSIONS		
Unit Dimensions (in)	Height	63-1/8
	Width	49-1/4
	Depth	30-1/8
Liquid Pipe Connection (in.)		1/2
Gas Pipe Connection (in.)		7/8
Net Weight (lb)		(2) 781


## SUBMITTAL DATA - OUTDOOR UNIT

### VPA168L4M-2G

VPA072L4M-2G + VPA096L4M-2G VRF LOW AMBIENT HEAT PUMP



#### DIMENSIONS - INCHES (MM)

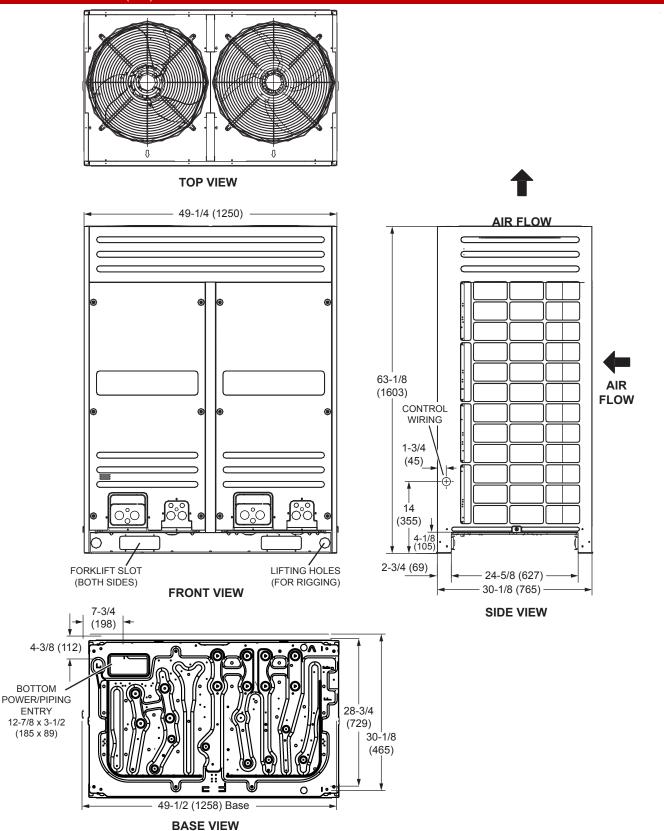

DISCLAIMER – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause properly damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495585 (201802) ©2018 Lenn