

SUBMITTAL DATA - OUTDOOR UNIT VPA168H4M-2G

VPA072H4M-2G + VPA096H4M-2G VRF HEAT PUMP

Job:	Engineer:
Location:	Architect:
Schedule No.:	Date:
System Designation:	For:
FEATURES	

FEATURES

- Two-pipe heat pump
- Accelerated complete coil defrost
- Hinged electrical box for ease of maintenance
- High efficiency DC Inverter scroll compressor
- Intelligent Duty Cycle operation
- Night Silent operation

WARRANTY

- Compressor 10 year limited warranty
- All other components 10 year limited warranty *See warranty for details

SPECIFICATIONS

SPECIFICATIONS		
PERFORMANCE		
Cooling Capacity ¹ (Btu/h)	Nominal	168,000
	Rated ²	160,000
EER	Ducted	12.20
	Non-Ducted	12.20
IEER	Ducted	22.40
	Non-Ducted	22.40
Heating Capacity ¹ (Btu/h)		180,000
COP47	Ducted	3.64
	Non-Ducted	3.74
COP17	Ducted	2.35
	Non-Ducted	2.50
ELECTRICAL DATA		
Power Supply ³ (V/Hz/Ph)		460/60/3
Minimum Circuit Ampacity (A)		18.7 + 20.0
Maximum Overcurrent Protection (A)		30 + 30
Compressor RLA (A)		14 + 15
No. of Compressors		1 + 1
Outdoor Fan Power Input (W)		(2) 260/260
Outdoor Fan FLA (A)		(2) 0.6/0.6
GENERAL DATA		
Connection Ratio		50% to 130%
Max. # of Indoor Units		29 units
Sound Pressure Level (dBA	()	62
Outdoor Fan Air Volume (cf	m)	(2) 7215
Refrigerant type		R-410A
Factory refrigerant charge (each unit)		28 lbs. 11 oz.



DIMENSIONS (each unit)		
Unit Dimensions (in)	Height Width	63-1/8
		49-1/2
	Depth	30-1/8
Liquid Pipe Connection (in)		1/2
Gas Pipe Connection (in)		7/8
Gas Balance Pipe Connection (in)	H.P.	3/4
	L.P.	7/8
Shipping Weight (lb)		668
Net Weight (Ib)		631

NOTES

- Cooling and Heating Capacity data is rated at the following conditions: Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Indoor
- 2. Complies with AHRI 1230-2014 testing standards

-11

CERTIFIED,

3. Operating Voltage Range: 423V to 497V






SUBMITTAL DATA - OUTDOOR UNIT VPA168H4M-2G

VPA072H4M-2G + VPA096H4M-2G VRF HEAT PUMP



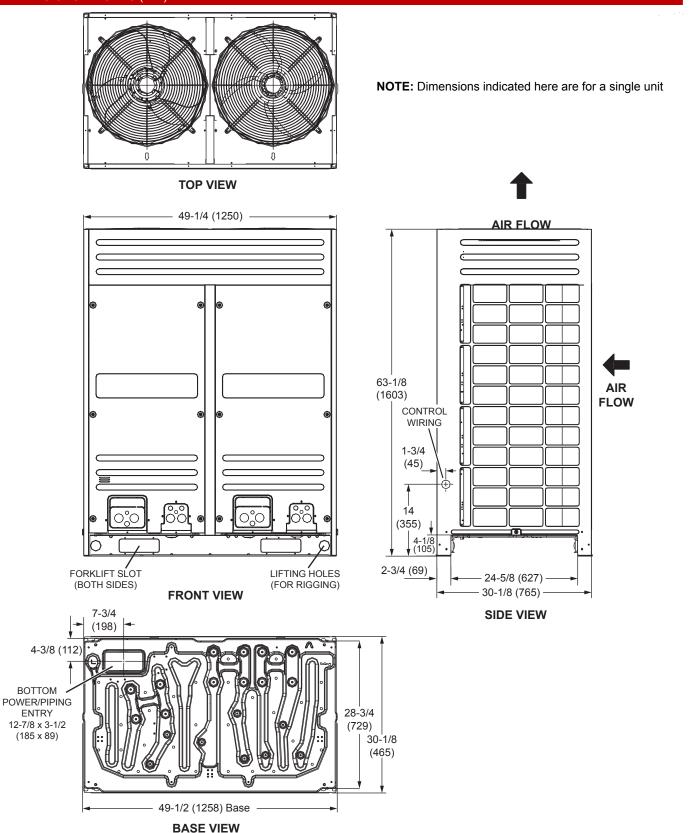

DISCLAIMER – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency. 495392 (201804) ©2018 Lenn