

Job:

Location:

Schedule No.:

System Designation:

High Static Ducted Indoor Unit

FEATURES

- Pre Heat Function
- Auto Addressing
- Auto Restart
- Optional Condensate Pump
 Electronic Expansion Valve
- Electronic Expansion valve
 Factory Secondary Drain Pan
- **SPECIFICATIONS** PERFORMANCE Cooling Capacity¹ (Btu/h) 30,000 Heating Capacity¹ (Btu/h) 34,100 Airflow (CFM) High 1,248 1,183 Medium Low 1.028 External Static Pressure (in. WC) 0.15 - 0.80 52 Sound Pressure (dBA) High Medium 49 47 Low ELECTRICAL DATA Power Supply (V/Hz/ Φ) 208-230/60/1 Minimum circuit ampacity (MCA) 2.5 Max. Overcurrent Protection (MOCP) 15 Cooling Power Input² (W) 430 Cooling Rated current (A) 2.05 Heating Power Input² (W) 430 Heating Rated current (A) 2.05 Indoor Fan Motor Input (W) 359 DIMENSIONS Unit Dimensions (in) Height 16-5/8 Width 37-1/2 Depth 27-1/8 Liquid Pipe Connection (in) 3/8 Gas Pipe Connection (in) 5/8 Condensate drain connection (in) (1) 1 - 1/4Unit Shipping Weight (lb) 125 110 Unit Net Weight (lb)

SUBMITTAL DATA – INDOOR UNIT VHIA030S4-2P

VRF HEAT PUMP & HEAT RECOVERY

Engineer:

Architect:

Date:

For: Reference Approval Review Construction

- Flare Connections
- LED Display
- Washable Filter
- Refrigerant R-410A
- Seven capacity sizes from 24,000 to 96,000 Btu/h



OPTIONAL ACCESSORIES

□Non-Programmable Controller	V0STAT54P
□Programmable Controller	V0STAT51P
□Infrared Wireless Controller	V0STAT52P-1
□Infrared Sensor	V0SNSR78P-1
□Remote Sensor	V0SNSR00P-1
□HHE Relay Kit	V0CTRL92P-1
Hotel Keycard Interface	V0CTRL88P-1
Optional Drain Pump Kit	V8DRNP04

NOTES

1. Cooling and Heating capacity data is rated at the following conditions:

Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor

2. Power Input values are rated at high fan speed.








SUBMITTAL DATA – INDOOR UNIT VHIA030S4-2P

VRF HEAT PUMP & HEAT RECOVERY

DIMENSIONAL DRAWINGS - INCHES (MM)

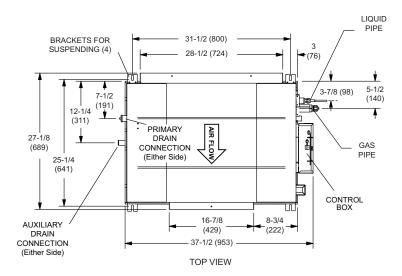

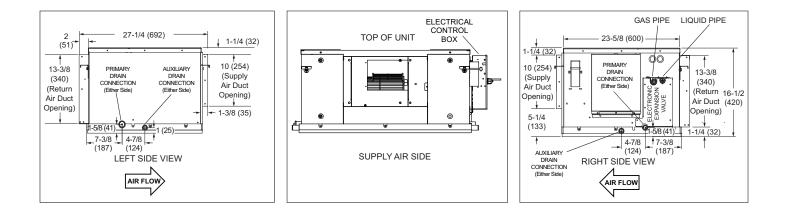

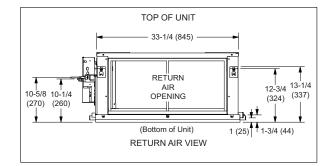

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.